



Certificate of Analysis

Product No.	26	Product Name	Palmatine chloride
Lot. No.	262606	Unit Quantity	20mg
Analysis Date	2026-06-25	Storage Conditions	Room temperature

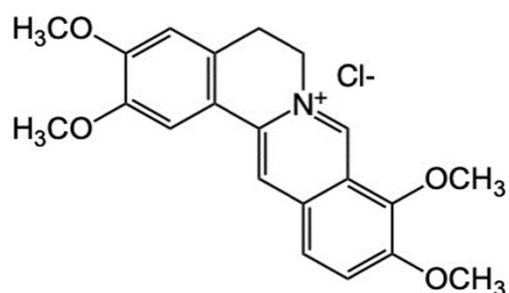

$C_{21}H_{22}ClNO_4$
 MW : 387.86
 CAS RN: 10605-02-4

This product conforms to the specifications in the 19th edition of the Japanese Pharmacopoeia, Reagents, Test Solutions, " Palmatin chloride".

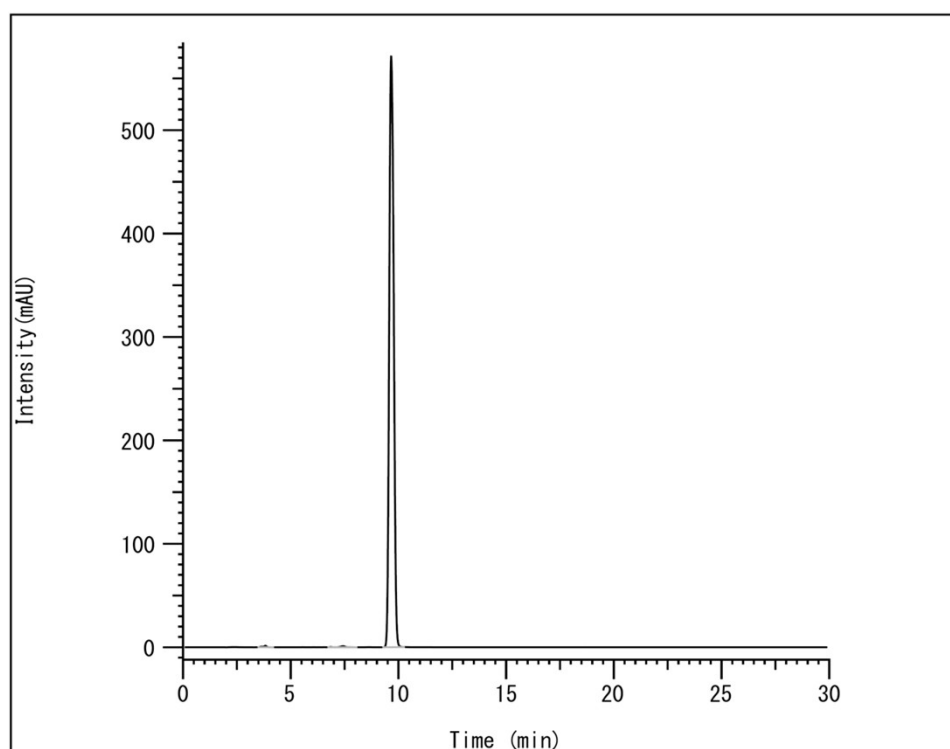

Retention time	Peak area	%
3.827	17725	0.21
7.440	19689	0.24
9.667	8285532	99.55
Total	8322946	100.00

Area percentage	: Not less than 99.0%
Detector	: An ultraviolet absorption photometer (345nm)
Column	: YMC-Pack ODS-A (ϕ 4.6 $\times$ 250mm)

Purity Related substances (HPLC)	Column temperature :	A constant temperature of about 40°C.	Passed (99.6%)
	Mobile phase :	Dissolve 3.4 g of potassium dihydrogen phosphate and 1.7 g of sodium lauryl sulfate in 1000 mL of a mixture of water and acetonitrile (1:1).	
	Flow rate :	Adjust so that the retention time of berberine is about 10 minutes.	
	Time span of measurement :	About twice as long as the retention time of palmatine chloride.	
Description			Passed
Purity Related substances (TLC)			Passed
Precautions Order quantities that can be used immediately, and after receipt of a reference standard, store it at the specified temperature and use it as soon as possible.			
Expiration Date		June 2030(unopened)	

4-201, Sakurazaka, Moriyama-ku, Nagoya City, Aichi Prefecture 463-0018, Japan

TEL : +81-52-715-5601

FAX : +81-52-715-5602